
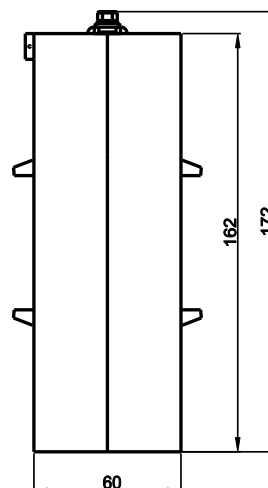


ISN 30

Current transformer bus-bar type ISN 30. Max bus-bar size 40×10 mm or 40×30 mm.

Max voltage $U_m = 1.2$ kV. Test voltage $U_p = 6$ kV.

I_{pn}	h 041 h1 = 10.5 mm; h2 = 42 mm; C= 60 mm						h 043 h1 = 33 mm; h2 = 42 mm; C= 60 mm					
	cl. 0.2S	cl. 0.2	cl. 0.5S	cl. 0.5	cl. 1	cl. 3	cl. 0.2S	cl. 0.2	cl. 0.5S	cl. 0.5	cl. 1	cl. 3
A	VA						VA					
100					2.5	2.5					2.5	2.5
					5	5					5	5
150					2.5	2.5					2.5	2.5
					5	5					5	5
						10						
200				2.5	2.5	2.5					2.5	2.5
					5	5					5	5
					10	10					10	10
250			2.5	2.5	2.5	2.5					2.5	2.5
				5	5	5					5	5
					10	10					10	10
300		2.5	2.5	2.5	2.5	2.5				2.5	2.5	2.5
				5	5	5				5	5	5
					10	10					10	10
400		2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
				5	5	5				5	5	5
					10	10				10	10	10
500		2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
		5	5	5	5	5	5	5	5	5	5	5
				10	10	10				10	10	10
				15	15	15				15	15	15
600	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
		5	5	5	5	5	5	5	5	5	5	5
				10	10	10				10	10	10
				15	15	15				15	15	15
750	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5	5	5	5	5	5	5
		10	10	10	10	10	10	10	10	10	10	10
				15	15	15	15	15	15	15	15	15
800	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5	5	5	5	5	5	5
	10	10	10	10	10	10	10	10	10	10	10	10
				15	15	15	15	15	15	15	15	15
1000	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5	5	5	5	5	5	5
	10	10	10	10	10	10	10	10	10	10	10	10
		15	15	15	15	15	15	15	15	15	15	15
1200							2.5	2.5	2.5	2.5	2.5	2.5
							5	5	5	5	5	5
							10	10	10	10	10	10
							15	15	15	15	15	15
1250							2.5	2.5	2.5	2.5	2.5	2.5
							5	5	5	5	5	5
							10	10	10	10	10	10
							15	15	15	15	15	15
1500							2.5	2.5	2.5	2.5	2.5	2.5
							5	5	5	5	5	5
							10	10	10	10	10	10
							15	15	15	15	15	15
1600							2.5	2.5	2.5	2.5	2.5	2.5
							5	5	5	5	5	5
							10	10	10	10	10	10
							15	15	15	15	15	15

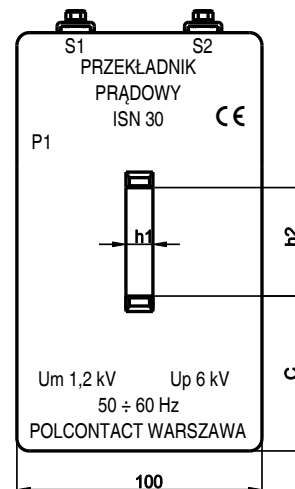

Rated secondary current $I_{sn} = 5$ A.

Rated secondary current $I_{sn} = 1$ A available on request.

Security factor for apparatus FS5.



Other parameters available on request after consultation with our Technical Department.

Example of order: ISN 30 h 041; 800/5 A; 5 VA; cl. 0.2S

ISN 30

Current transformer bus-bar type ISN 30. Max bus-bar size 50×10 mm or 50×30 mm.

Max voltage $U_m = 1.2$ kV. Test voltage $U_p = 6$ kV.

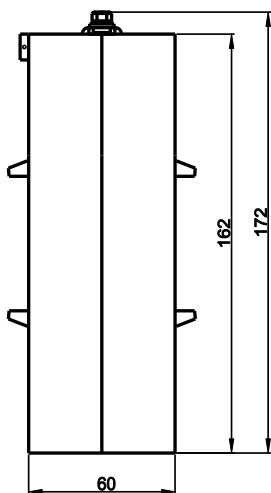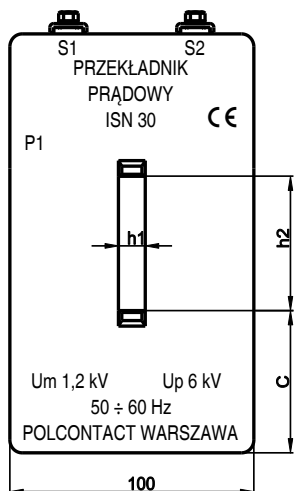

I_{pn}	h 051 h1 = 10.5 mm; h2 = 52 mm; C = 55 mm						h 053 h1 = 33 mm; h2 = 52 mm; C = 55 mm					
	cl. 0.2S	cl. 0.2	cl. 0.5S	cl. 0.5	cl. 1	cl. 3	cl. 0.2S	cl. 0.2	cl. 0.5S	cl. 0.5	cl. 1	cl. 3
A	VA						VA					
100					2.5	2.5					2.5	2.5
					5	5					5	5
					2.5	2.5					2.5	2.5
150					5	5					5	5
						10						
				2.5	2.5	2.5					2.5	2.5
					5	5					5	5
					10	10					10	10
200												
				2.5	2.5	2.5					2.5	2.5
					5	5					5	5
					10	10					10	10
250												
				2.5	2.5	2.5					2.5	2.5
					5	5					5	5
					10	10					10	10
300												
				2.5	2.5	2.5				2.5	2.5	2.5
					5	5				5	5	5
					10	10					10	10
400												
				2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
					5	5				5	5	5
					10	10				10	10	10
500												
				2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
					5	5		5	5	5	5	5
					10	10				10	10	10
					15	15				15	15	15
600												
				2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
					5	5		5	5	5	5	5
					10	10				10	10	10
					15	15				15	15	15
750												
				2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
					5	5		5	5	5	5	5
					10	10		10	10	10	10	10
					15	15		15	15	15	15	15
800												
				2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
					5	5		5	5	5	5	5
					10	10		10	10	10	10	10
					15	15		15	15	15	15	15
1000												
				2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
					5	5		5	5	5	5	5
					10	10		10	10	10	10	10
					15	15		15	15	15	15	15
1200												
				2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
					5	5		5	5	5	5	5
					10	10		10	10	10	10	10
					15	15		15	15	15	15	15
1250												
				2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
					5	5		5	5	5	5	5
					10	10		10	10	10	10	10
					15	15		15	15	15	15	15
1500												
								2.5	2.5	2.5	2.5	2.5
								5	5	5	5	5
								10	10	10	10	10
								15	15	15	15	15
1600												
								2.5	2.5	2.5	2.5	2.5
								5	5	5	5	5
								10	10	10	10	10
								15	15	15	15	15

Rated secondary current $I_{sn} = 5$ A.

Rated secondary current $I_{sn} = 1$ A available on request.

Security factor for apparatus FS5.

Other parameters available on request after consultation with our Technical Department.



Example of order: ISN 30 h 053; 1000/5 A; 5 VA; cl. 0.2S

ISN 30

Current transformer bus-bar type ISN 30. Max bus-bar size 60×10 mm or 60×30 mm.

Max voltage $U_m = 1.2$ kV. Test voltage $U_p = 6$ kV.

I_{pn}	h 061 h1 = 10.5 mm; h2 = 62 mm; C = 50 mm						h 063 h1 = 33 mm; h2 = 62 mm; C = 50 mm					
	cl. 0.2S	cl. 0.2	cl. 0.5S	cl. 0.5	cl. 1	cl. 3	cl. 0.2S	cl. 0.2	cl. 0.5S	cl. 0.5	cl. 1	cl. 3
A	VA						VA					
100					2.5	2.5					2.5	2.5
					5	5					5	5
150					2.5	2.5					2.5	2.5
					5	5					5	5
200				2.5	2.5	2.5					2.5	2.5
					5	5					5	5
					10	10					10	10
250				2.5	2.5	2.5					2.5	2.5
					5	5					5	5
					10	10					10	10
300		2.5	2.5	2.5	2.5	2.5				2.5	2.5	2.5
					5	5				5	5	5
					10	10				10	10	10
400		2.5	2.5	2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
		5	5	5	5	5				5	5	5
					10	10				10	10	10
500	2.5	2.5	2.5	2.5	2.5	2.5		2.5	2.5	2.5	2.5	2.5
		5	5	5	5	5		5	5	5	5	5
					10	10				10	10	10
					15	15				15	15	15
600	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5		5	5	5	5	5
					10	10				10	10	10
					15	15				15	15	15
750	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5		5	5	5	5	5
	10	10	10	10	10	10		10	10	10	10	10
	15	15	15	15	15	15		15	15	15	15	15
800	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5		5	5	5	5	5
	10	10	10	10	10	10		10	10	10	10	10
	15	15	15	15	15	15		15	15	15	15	15
1000	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5		5	5	5	5	5
	10	10	10	10	10	10		10	10	10	10	10
	15	15	15	15	15	15		15	15	15	15	15
1200	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5		5	5	5	5	5
	10	10	10	10	10	10		10	10	10	10	10
	15	15	15	15	15	15		15	15	15	15	15
1250	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5		5	5	5	5	5
	10	10	10	10	10	10		10	10	10	10	10
	15	15	15	15	15	15		15	15	15	15	15
1500	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5		5	5	5	5	5
	10	10	10	10	10	10		10	10	10	10	10
	15	15	15	15	15	15		15	15	15	15	15
1600	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	5	5	5	5	5	5		5	5	5	5	5
	10	10	10	10	10	10		10	10	10	10	10
	15	15	15	15	15	15		15	15	15	15	15
2000							2.5	2.5	2.5	2.5	2.5	2.5
							5	5	5	5	5	5
							10	10	10	10	10	10
							15	15	15	15	15	15

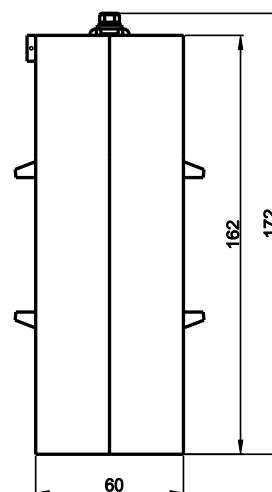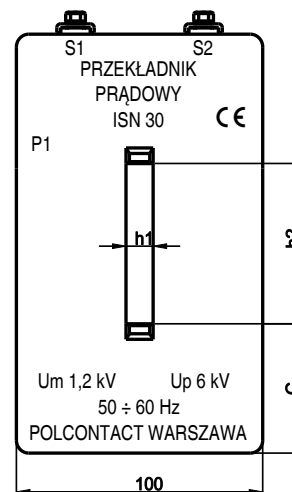

Rated secondary current $I_{sn} = 5$ A.
Rated secondary current $I_{sn} = 1$ A available on request.

Security factor for apparatus FS5.
Other parameters available on request after consultation with our Technical Department.

Example of order: ISN 30 h 061; 600/5 A; 2.5 VA; cl. 0.2S