
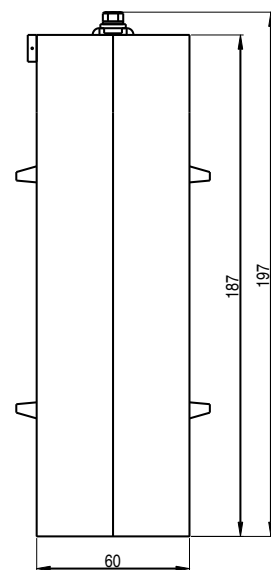


# ISN 31

Current transformer bus-bar type ISN 31. Max bus-bar size 2×80×10 mm.

Max voltage  $U_m = 1.2$  kV. Test voltage  $U_p = 6$  kV.

ISN 31						
h 083						
$I_{pn}$	kl. 0.2S	kl. 0.2	kl. 0.5S	kl. 0.5	kl. 1	kl. 3
A	VA					
300				5	5	5
					10	10
400				5	5	5
				10	10	10
500			5	5	5	5
			10	10	10	10
600			5	5	5	5
			10	10	10	10
750		5	5	5	5	5
			10	10	10	10
800		5	5	5	5	5
			10	10	10	10
1000		5	5	5	5	5
		10	10	10	10	10
1200		5	5	5	5	5
		10	10	10	10	10
1250		5	5	5	5	5
		10	10	10	10	10
1500		5	5	5	5	5
		10	10	10	10	10
1600		5	5	5	5	5
		10	10	10	10	10
2000	5	5	5	5	5	5
	10	10	10	10	10	10
2500	5	5	5	5	5	5
	10	10	10	10	10	10
3000	5	5	5	5	5	5
	10	10	10	10	10	10

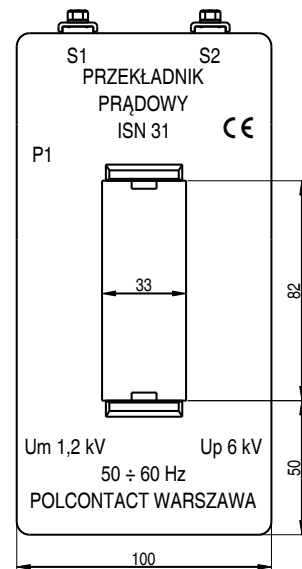

Rated secondary current  $I_{sn} = 5$  A.  
 Rated secondary current  $I_{sn} = 1$  A available on request.  
 Security factor for apparatus FS5.



Other parameters available on request after consultation with our Technical Department.

Example of order: ISN 31 h 083; 2000/5 A; 10 VA; kl. 0.5S

# ISN 32

Current transformer bus-bar type ISN 32. Max bus-bar size 2×100×10 mm.

Max voltage  $U_m = 1.2$  kV. Test voltage  $U_p = 6$  kV.

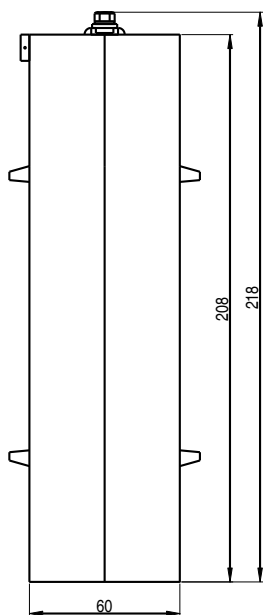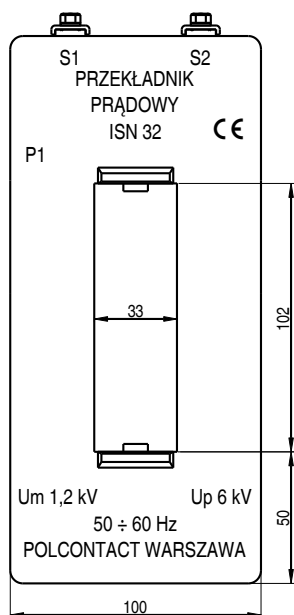

Rated secondary current

$I_{sn} = 5$  A.

Rated secondary current

$I_{sn} = 1$  A available on request.

		ISN 32					
		h 103					
$I_{pn}$		cl. 0.2S	cl. 0.2	cl. 0.5S	cl. 0.5	cl. 1	cl. 3
A	VA						
300					5	5	5
						10	10
						15	15
400					5	5	5
						10	10
						15	15
500				5	5	5	5
				10	10	10	10
					15	15	15
600				5	5	5	5
				10	10	10	10
					15	15	15
750			5	5	5	5	5
				10	10	10	10
				15	15	15	15
800			5	5	5	5	5
				10	10	10	10
				15	15	15	15
1000			5	5	5	5	5
			10	10	10	10	10
			15	15	15	15	15
					20	20	20
1200					30	30	30
			5	5	5	5	5
			10	10	10	10	10
			15	15	15	15	15
1250					20	20	20
					30	30	30
			5	5	5	5	5
			10	10	10	10	10
1500					15	15	15
					20	20	20
			5	5	5	5	5
			10	10	10	10	10
1600					15	15	15
					20	20	20
			5	5	5	5	5
			10	10	10	10	10
2000					15	15	15
					20	20	20
			5	5	5	5	5
			10	10	10	10	10
2500					15	15	15
					20	20	20
			5	5	5	5	5
			10	10	10	10	10
3000					15	15	15
					20	20	20
			5	5	5	5	5
			10	10	10	10	10

Security factor for apparatus FS5.



Other parameters available on request after consultation with our Technical Department.

Example of order: ISN 32 h 083; 1500/5 A; 10 VA; cl. 0.2

# ISN 33

Current transformer bus-bar type ISN 33. Max bus-bar size 2×120×10 mm. For vertical bus-bar.  
Max voltage  $U_m = 1.2$  kV. Test voltage  $U_p = 6$  kV.

		ISN 33					
		h 123					
$I_{pn}$		cl. 0.2S	cl. 0.2	cl. 0.5S	cl. 0.5	cl. 1	cl. 3
A							
300					5	5	5
						10	10
						15	15
400					5	5	5
						10	10
						15	15
500				5	5	5	5
				10	10	10	10
				15	15	15	15
600				5	5	5	5
				10	10	10	10
				15	15	15	15
750		5	5	5	5	5	5
			10	10	10	10	10
			15	15	15	15	15
800		5	5	5	5	5	5
			10	10	10	10	10
			15	15	15	15	15
1000		5	5	5	5	5	5
		10	10	10	10	10	10
		15	15	15	15	15	15
				20	20	20	20
				30	30	30	30
1200		5	5	5	5	5	5
		10	10	10	10	10	10
		15	15	15	15	15	15
				20	20	20	20
				30	30	30	30
1250		5	5	5	5	5	5
		10	10	10	10	10	10
		15	15	15	15	15	15
				20	20	20	20
				30	30	30	30
1500		5	5	5	5	5	5
		10	10	10	10	10	10
		15	15	15	15	15	15
		20	20	20	20	20	20
				30	30	30	30
1600		5	5	5	5	5	5
		10	10	10	10	10	10
		15	15	15	15	15	15
		20	20	20	20	20	20
				30	30	30	30
2000	5	5	5	5	5	5	5
	10	10	10	10	10	10	10
	15	15	15	15	15	15	15
		20	20	20	20	20	20
				30	30	30	30
2500	5	5	5	5	5	5	5
	10	10	10	10	10	10	10
	15	15	15	15	15	15	15
		20	20	20	20	20	20
		30	30	30	30	30	30
3000	5	5	5	5	5	5	5
	10	10	10	10	10	10	10
	15	15	15	15	15	15	15
	20	20	20	20	20	20	20
	30	30	30	30	30	30	30

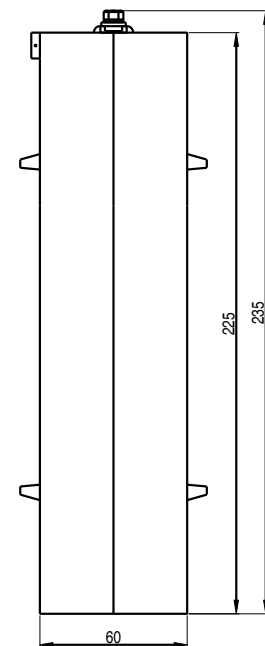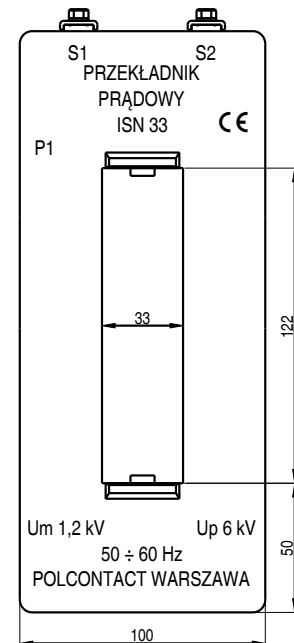

Rated secondary current  
 $I_{sn} = 5$  A.  
Rated secondary current  
 $I_{sn} = 1$  A available on request.

Security factor for apparatus FS5.

Other parameters available on request after consultation with our Technical Department.

Example of order: ISN 33 h 123; 2500/5 A; 5 VA; cl. 0.2S