


ISN 5

Current transformer ISN 5 for horizontal bus 2×140×10 mm.

Max voltage $U_m = 1,2$ kV; test voltage $U_p = 6$ kV.

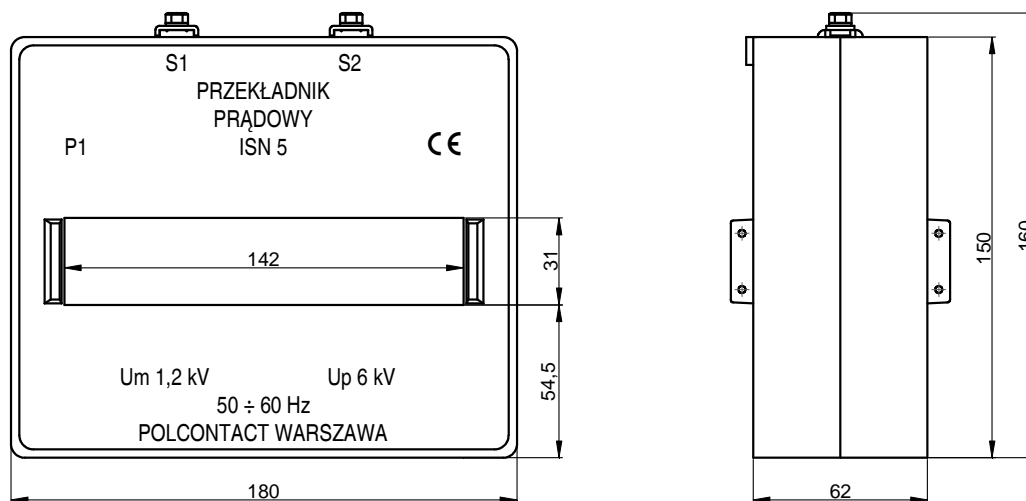

ISN 5						
h 143						
I_{pn}	cl. 0,2S	cl. 0,2	cl. 0,5S	cl. 0,5	cl. 1	cl. 3
A	VA					
2000	5	5	5	5	5	5
	10	10	10	10	10	10
	15	15	15	15	15	15
	20	20	20	20	20	20
	30	30	30	30	30	30
2500	5	5	5	5	5	5
	10	10	10	10	10	10
	15	15	15	15	15	15
	20	20	20	20	20	20
	30	30	30	30	30	30
3000	5	5	5	5	5	5
	10	10	10	10	10	10
	15	15	15	15	15	15
	20	20	20	20	20	20
	30	30	30	30	30	30
3500	5	5	5	5	5	5
	10	10	10	10	10	10
	15	15	15	15	15	15
	20	20	20	20	20	20
	30	30	30	30	30	30
4000	5	5	5	5	5	5
	10	10	10	10	10	10
	15	15	15	15	15	15
	20	20	20	20	20	20
	30	30	30	30	30	30

Rated secondary current $I_{sn} = 5$ A. Security factor for apparatus FS5.

Other parameters available on request after consultation with our Technical Department.

Example of order: current transformer ISN 5 h 143; 2000/5 A; 10 VA; cl. 0,5S